REV	REVISION	BY	ECN	DATE





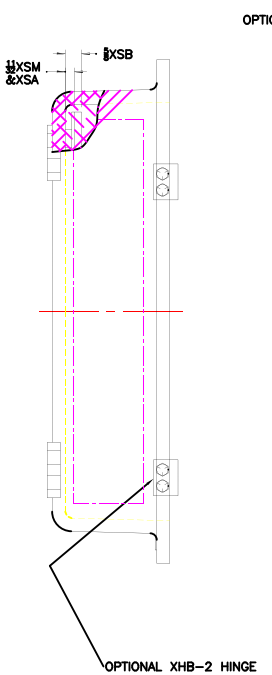

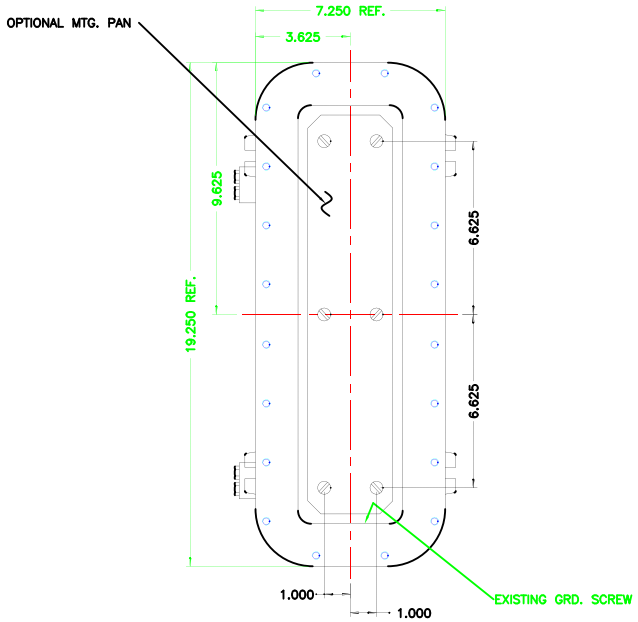

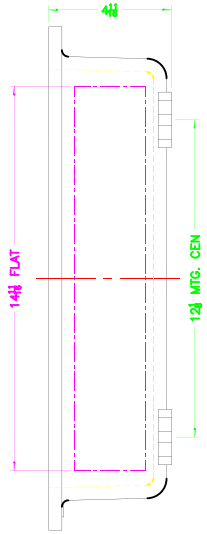

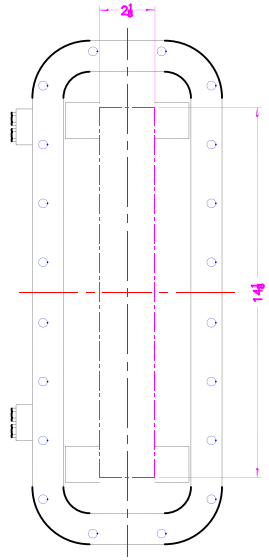

XCE 0416 COVER



COVER DRILLING ALLOWABLE IN XCE ONLY

NOTES:

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1 1/16.
2. MINIMUM SPACING BETWEEN ¾–14 NPSM OPERATOR CENTERS IS 2½ FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 5.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE 3/8 BOLT.

DO NOT SCALE DRAWING

ADALET
A SCOTT FETZER COMPANY
Enclosure Systems Cable Accessories

NOTICE TO PERSONS RECEIVING THIS DRAWING

MATERIAL

FINISH TUMBLAST

CAT NO XCE/XJF 041604

TITLE MODIFIED XCE/XJF 041604 ENCLOSURE FOR

DRAWN BY	DDH	DATE	4-20-01
ENG APPROVAL		PLOT SCALE	1=2.5
MFG APPROVAL		DWG SIZE	D
DWG NO		SHT	1OF1
		REV	