REV	REVISION	BY	ECN	DATE

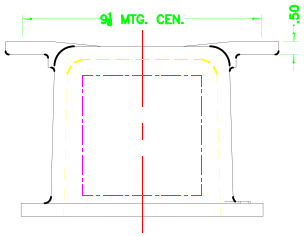



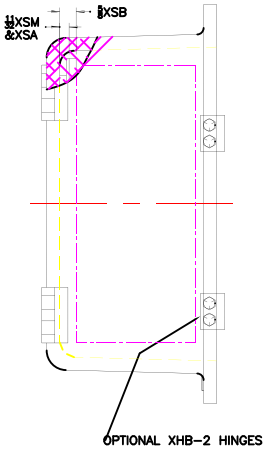

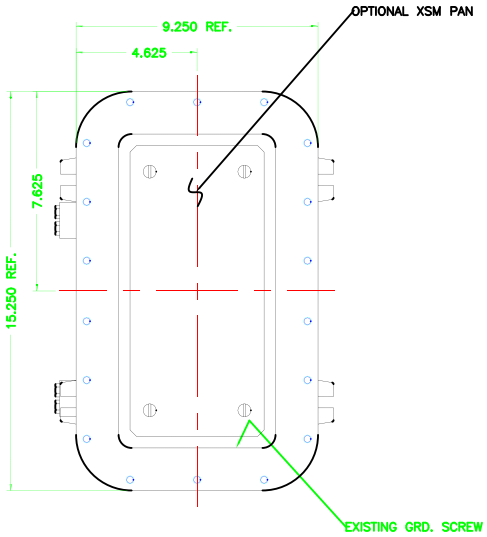

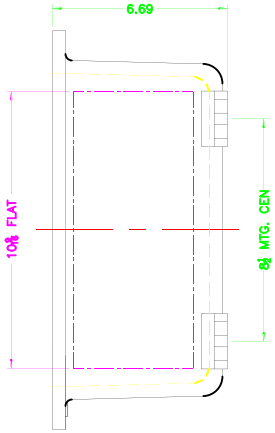

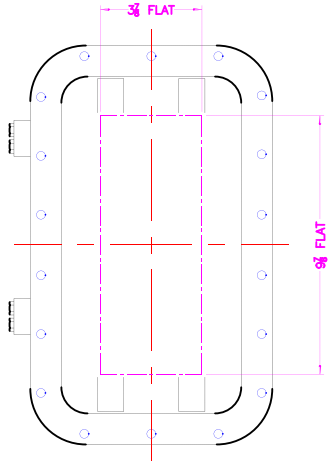

XCE 0612 COVER

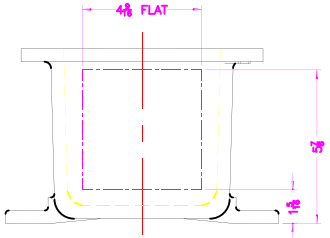

COVER DRILLING ALLOWABLE IN XCE ONLY

NOTES:

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1 1/16.
2. MINIMUM SPACING BETWEEN ¾–14 NPSM OPERATOR CENTERS IS 2½ FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 4.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE 3/8 BOLT.

DO NOT SCALE DRAWING

ADALET
A SCOTT FETZER COMPANY
Enclosure Systems Cable Accessories

TITLE: MODIFIED XCE/XJF 061206 ENCLOSURE FOR

DRAWN BY	DDH	DATE	5-10-01
ENG APPROVAL		PLOT SCALE	1=2.5
MFG APPROVAL		DWG SIZE	D
FINISH	TUMBLAST	DWG NO	SHT 1OF1 REV
CAT NO	XCE/XJF 061206		