REV	REVISION	BY	ECN	DATE

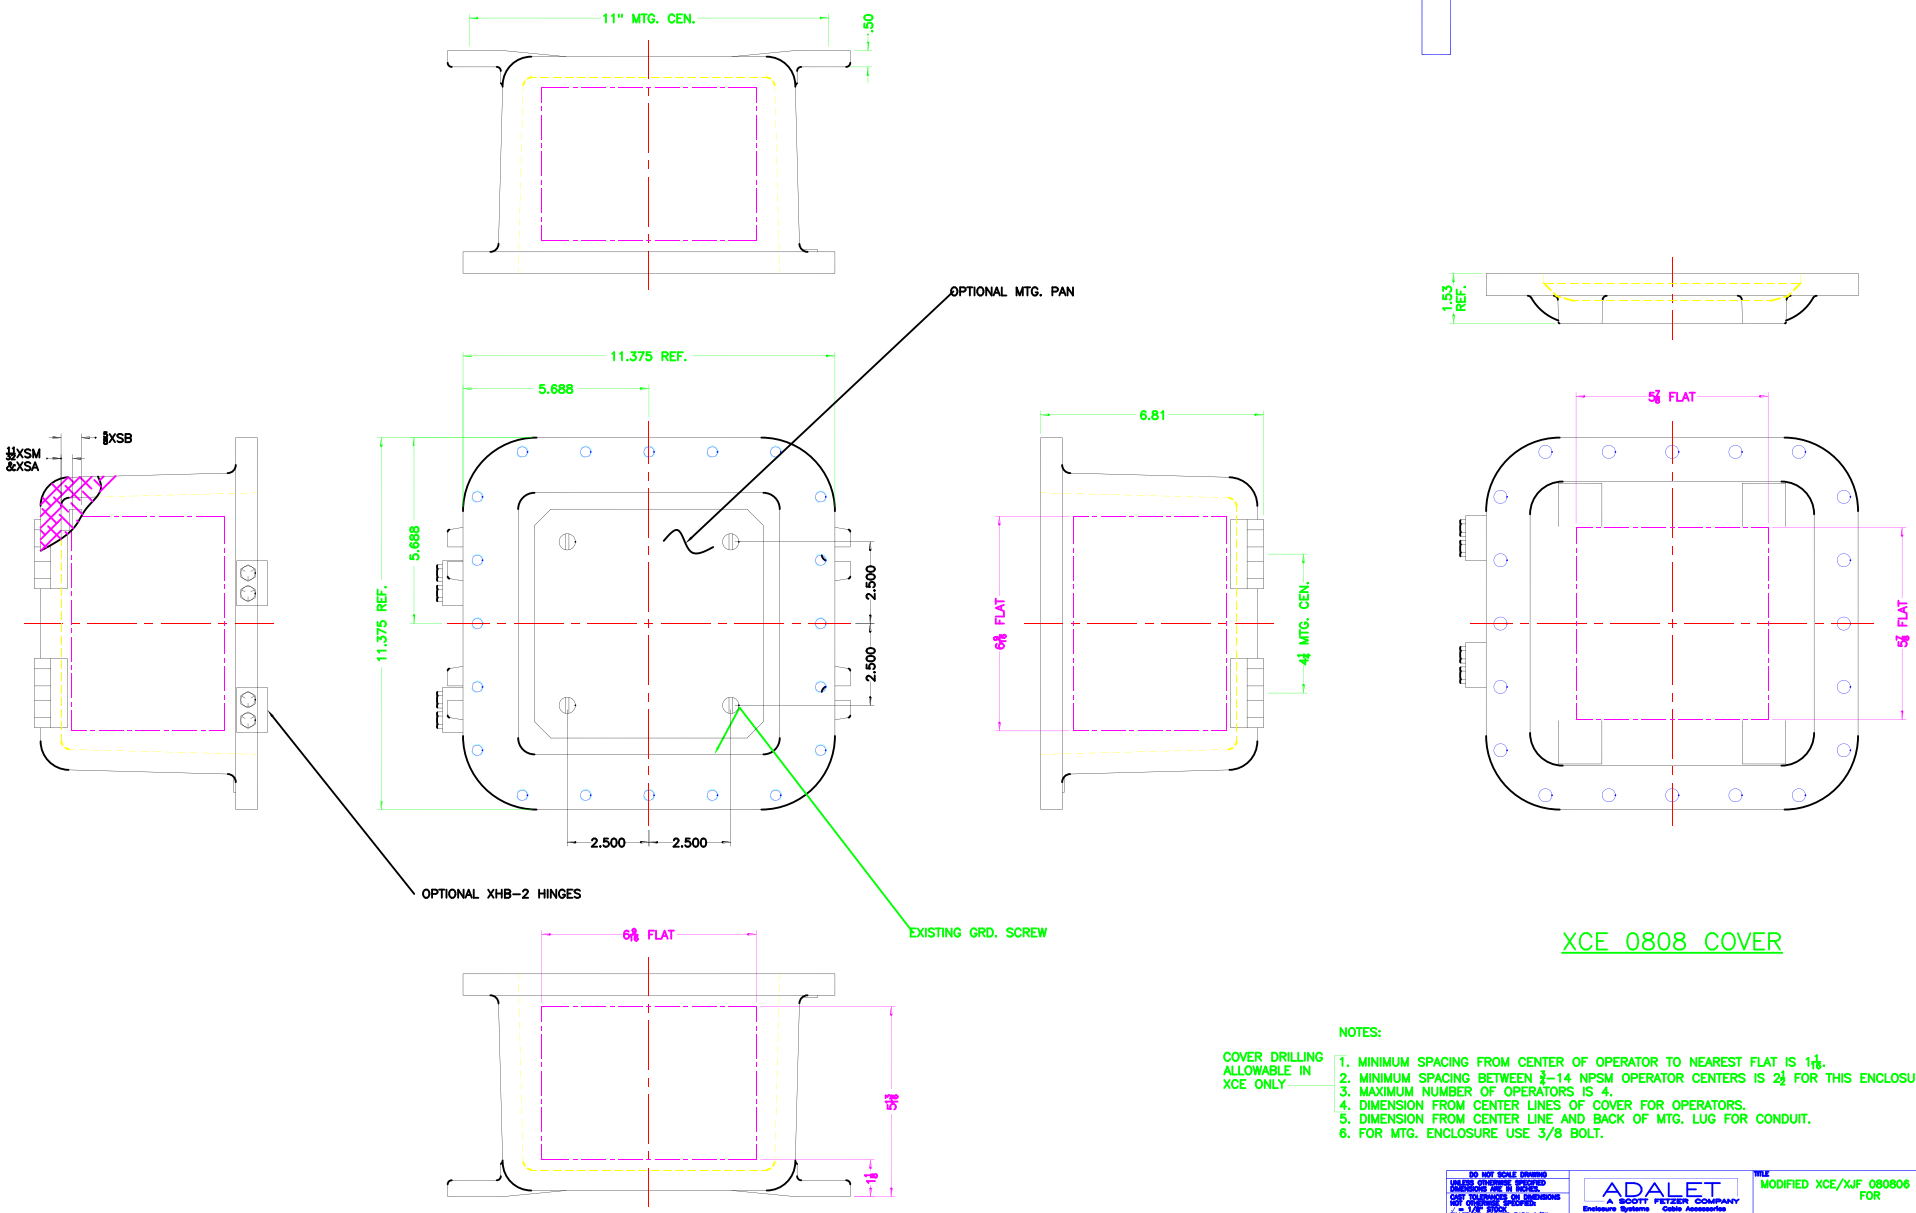

XCE 0808 COVER

NOTES:

COVER DRILLING ALLOWABLE IN XCE ONLY

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS $1\frac{1}{16}$.
2. MINIMUM SPACING BETWEEN $\frac{3}{4}$-14 NPSM OPERATOR CENTERS IS $2\frac{1}{2}$ FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 4.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE 3/8 BOLT.

DO NOT SCALE DRAWING
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES.
FOR TOLERANCES ON DIMENSIONS SEE CORPORATE STANDARDS.
+ 1/2° ANGLES
FILLET OR CORNER RADII 1/8"
DRAFT 1 1/2°
TOL. ±1/2
ANGLES ± 1°
MACHINE TOLERANCES ON DIMENSIONS NOT OTHERWISE SPECIFIED:
± 1/2
FILL 1/2 .XXX ± .010"
FILL 1/4 .XXX ± .005"
FILLET RADII .030"-.010" R. or 45°
ANGLES ± 0-30'
COARSE END THREADED HOLES NOT THROUGH
FOR THREADED HOLES SEE CORPORATE STANDARDS
NPSM E-37-1.0

ADALET
A SCOTT FETZER COMPANY
Enclosure Systems Cable Accessories

NOTICE TO PERSONS RECEIVING THIS DRAWING
ADALET, A SCOTT FETZER COMPANY, RETAINS ALL THE EXCLUSIVE RIGHTS, TITLE, AND INTEREST IN THIS DRAWING. IT IS LOANED FOR INFORMATION & REFERENCE ONLY AND NOT TO BE REPRODUCED OR LEFT IN POSSESSION, PERMANENT OR TEMPORARY, OF ANY PERSON OR ENTITY, INCLUDING, WITHOUT LIMITATION, ANY COPY OR ELECTRONIC SOURCE, WHICH POSSESSION THEREOF MUST BE THE OWNER.

MATERIAL
FINISH: TUMBLAST
CAT NO: XCE/XJF 080806

TITLE: MODIFIED XCE/XJF 080806 ENCLOSURE FOR

DRAWN BY	DDH	DATE	6-12-01
ENG APPROVAL		PLOT SCALE	1=2
MFG APPROVAL		DWG SIZE	D
DWG NO		SHT	1OF1
		REV	