REV	REVISION	BY	ECN	DATE

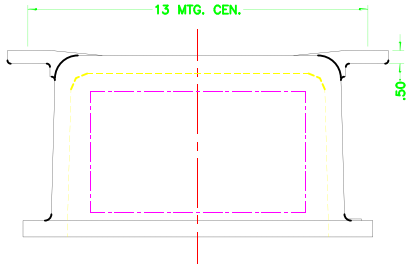



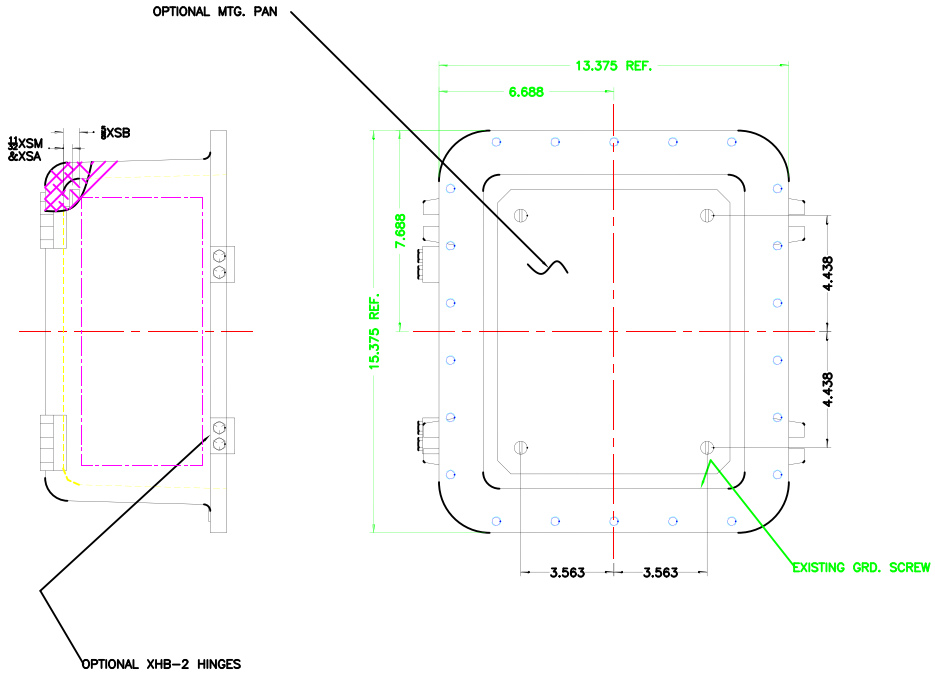

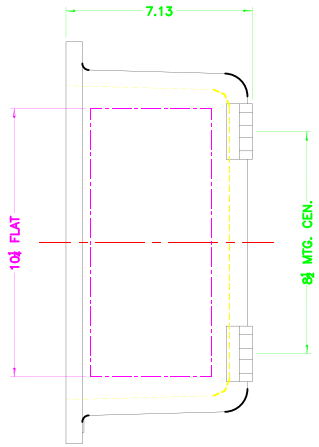

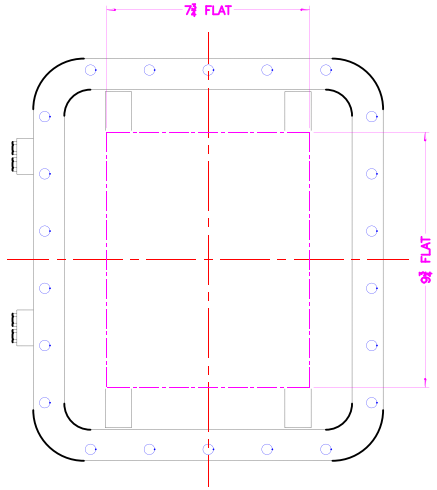

XCE 1012 COVER

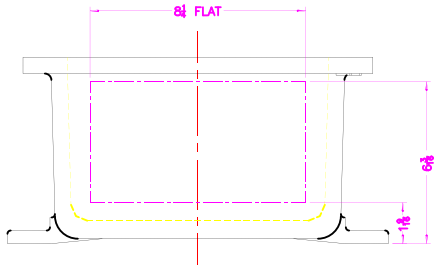

COVER DRILLING ALLOWABLE IN XCE ONLY

NOTES:

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS $1\frac{1}{16}$.
2. MINIMUM SPACING BETWEEN $\frac{3}{4}$–14 NPSM OPERATOR CENTERS IS $2\frac{1}{2}$ FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 12.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE 3/8 BOLT.

DO NOT SCALE DRAWING

ADALET
A SCOTT FETZER COMPANY
Enclosure Systems Cable Accessories

MATERIAL: SEE NOTES
FINISH: TUMBLAST
CAT NO: XCE/XJF 101206

TITLE: MODIFIED XCE/XJF 101206 ENCLOSURE FOR

DRAWN BY	DDH	DATE	8-24-01
ENG APPROVAL		PLOT SCALE	1=2.5
MFG APPROVAL		DWG SIZE	D
DWG NO		SHT	1OF1
		REV	