REV	REVISION	BY	ECN	DATE

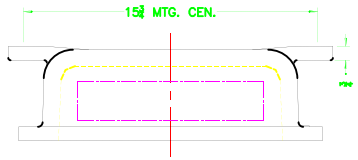



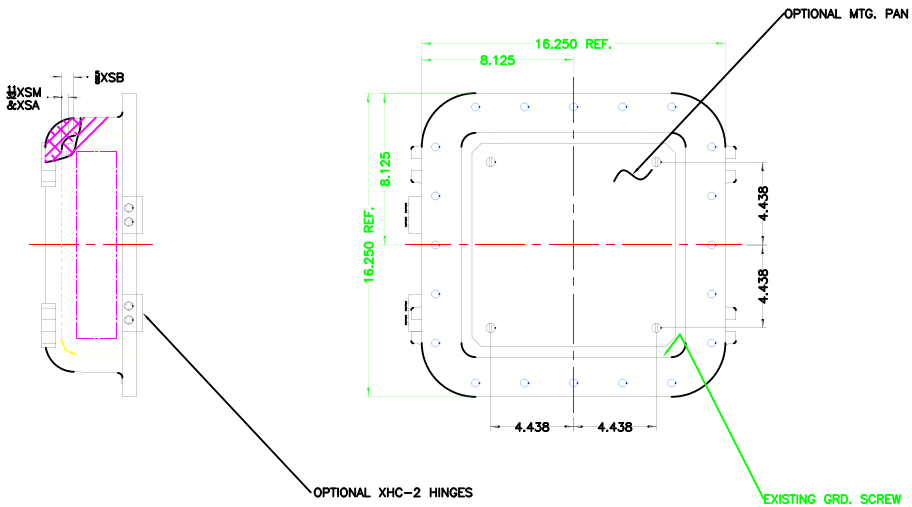

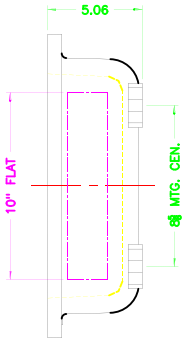

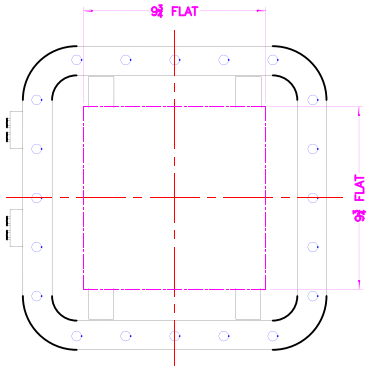

XCE 1212 COVER

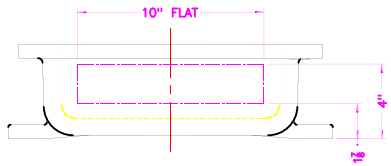

COVER DRILLING ALLOWABLE IN XCE ONLY

NOTES:

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1 1/16.
2. MINIMUM SPACING BETWEEN ¾–14 NPSM OPERATOR CENTERS IS 3 FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 9.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE ½ BOLT.

DO NOT SCALE DRAWING
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES.
CAST TOLERANCES ON DIMENSIONS NOT CONTROLLED BY MACHINING
± 1/8" UNLESS OTHERWISE SPECIFIED
RADII 1/16"
FILLET 1/16"
TYP. 0.1/16"
ANGLES 1°
MACHINE TOLERANCES ON DIMENSIONS NOT CONTROLLED BY CASTING UNLESS OTHERWISE SPECIFIED
± .005" .XXX ± .010"
FILLET .030" .XXX ± .010"
ANGLE WHERE .030"-.010" IS ± 45'
ANGLE ± 0-30'
COVER BOLT THREAD HOLES
BOLT THREAD SPECIFIED
TYP. 6-32-1.0
NPSM 6-32-1.0

ADALET
A SCOTT FETZER COMPANY
Enclosure Systems Cable Accessories

NOTICE TO PERSONS RECEIVING THIS DRAWING
ADALET HAS CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL DISCLOSED HEREIN. THIS DRAWING IS LOANED SUBJECT TO AGREEMENT THAT IT WILL BE USED ONLY AS AN AID TO PROPOSALS OR ORDERS TO ADALET. ACCEPTANCE OF ANY ORDER BASED THEREON SHALL CONSTITUTE AGREEMENT TO THESE TERMS.

MATERIAL
FINISH TUMBLAST
CAT NO XCE/XJF 121204

TITLE MODIFIED XCE/XJF 121204 ENCLOSURE FOR

DRAWN BY	DDH	DATE	11-09-01
ENG APPROVAL		PLOT SCALE	1=3.5
MFG APPROVAL		DRG SIZE	D
DRG NO		SHT	1OF1
		REV	