REV	REVISION	BY	ECN	DATE

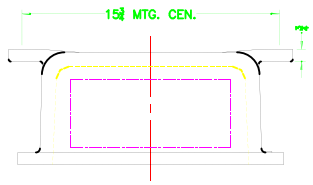

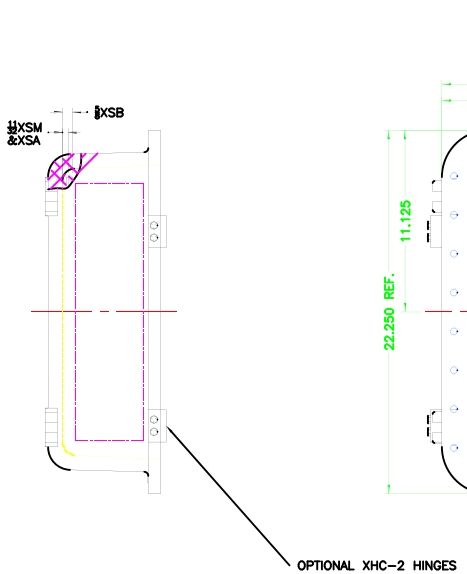

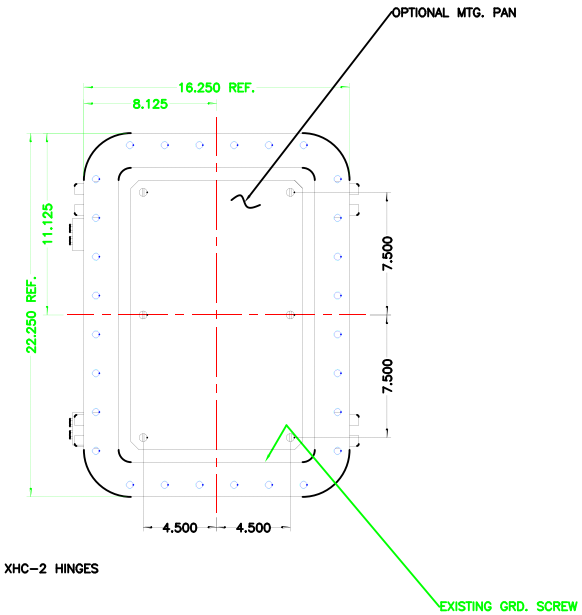

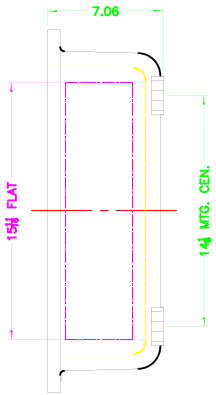

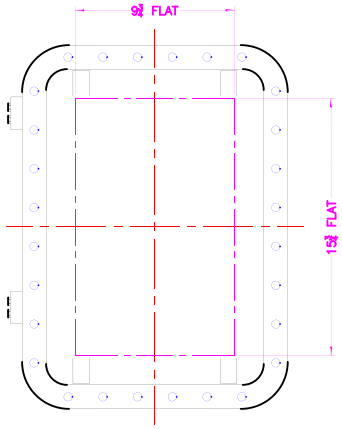

XCE 1218 COVER

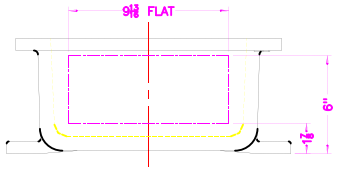

COVER DRILLING ALLOWABLE IN XCE ONLY

NOTES:

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS $1\frac{1}{16}$.
2. MINIMUM SPACING BETWEEN $\frac{3}{4}$–14 NPSM OPERATOR CENTERS IS 3" FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 15.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE $\frac{1}{4}$ BOLT.

DO NOT SCALE DRAWING
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES.
CAST TOLERANCE ON DIMENSIONS NOT OTHERWISE SPECIFIED
± 1/8" BASIC
FILLET R, CORNER RADII 1/8"
DRAFT 1°
TYP. 0.1/0"
ANGLES 1°
MACHINE TOLERANCES ON DIMEN. SCALE NOT OTHERWISE SPECIFIED
± 1/64"
FILLET R .062" .XXX ± .010"
CHAMFER WIDTH .062"–.010" R, or 45°
ANGLES ± 0–30'
DRILLING FOR STRAIGHT HOLES
SLOT TOLERANCE SPECIFIED
HOLE Ø .01"–1.0

ADALET
A SCOTT FETZER COMPANY
Enclosure Systems Cable Accessories

NOTICE TO PERSONS RECEIVING THIS DRAWING
WHICH ARE THE PROPERTY RIGHTS IN THE SUBJECT MATTER THEREOF. THIS DRAWING IS ISSUED IN CONFIDENCE FOR INFORMATION, ESTIMATING, REFERENCE OR USE BY EMPLOYEES OF RECIPIENT AND NOT TO BE COPIED OR REPRODUCED, LOANED, GIVEN OR SOLD, NOR ITS CONTENTS DISCLOSED TO OTHERS WITHOUT WRITTEN CONSENT OF ADALET. ACCEPTANCE OF THIS DRAWING CONSTITUTES AGREEMENT TO THE ABOVE.

MATERIAL
FINISH TUMBLAST
CAT NO XCE/XJF 121806

TITLE MODIFIED XCE/XJF 121806 ENCLOSURE FOR

DRAWN BY	DDH	DATE	11–12–01
ENG APPROVAL		PLOT SCALE	1=4
MFG APPROVAL		DWG SIZE	D
DWG NO		SHT	1OF1
		REV	