REV	REVISION	BY	ECN	DATE

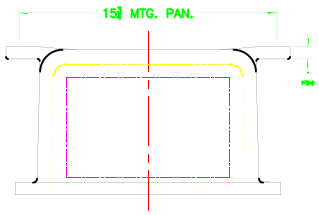



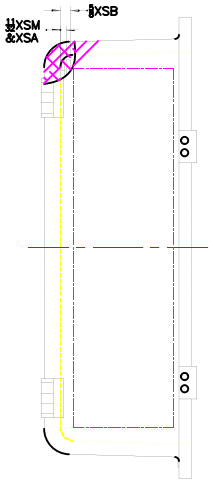

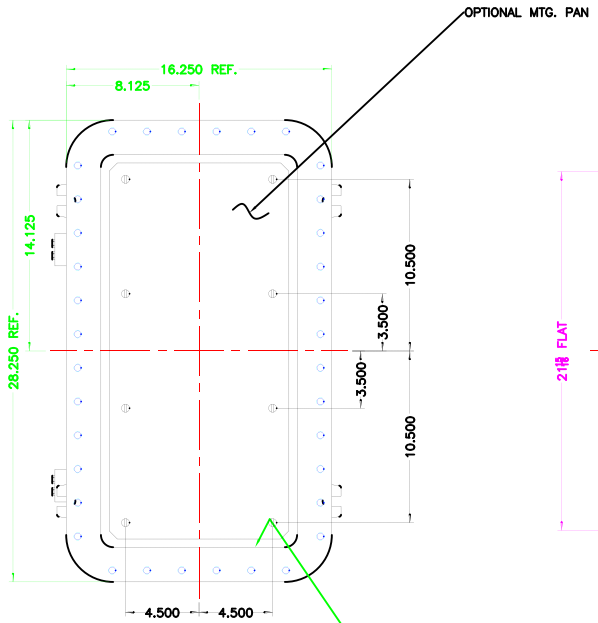

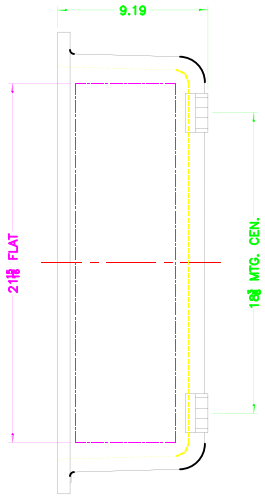

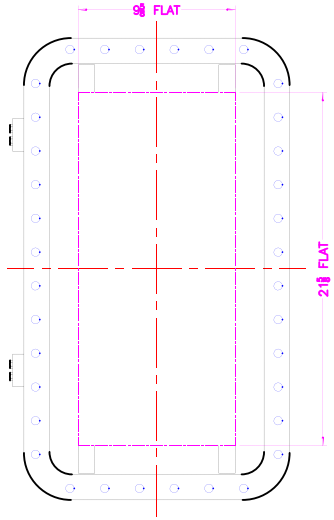

XCE 1224 COVER

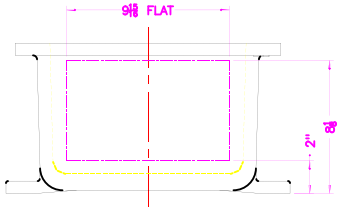

COVER DRILLING ALLOWABLE IN XCE ONLY

NOTES:

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1 1/16.
2. MINIMUM SPACING BETWEEN ⅞–14 NPSM OPERATOR CENTERS IS 3 FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 21.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE ¼ BOLT.

DO NOT SCALE DRAWING
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES.
CRITICAL TOLERANCES OR DIMENSIONS ARE SHOWN THUS: .XXX ± .005"
FILLET TO COVER RADII 1/8"
RADII 1/16
ANGLES 1°
MACHINE TOLERANCES ON DRILL SIZES NOT OTHERWISE SPECIFIED:
.XXX ± .010"
.XX ± .02"
FINISH MARKS .XXX ± .010" R. or 45°
ANGLES 0°-30'
CASTING DRILL SPACING HOLES
.XXX ± .010"
.XX ± .02"
.X ± 0°-1.0

ADALET
A SCOTT FETZER COMPANY
Enclosure Systems Cable Accessories

NOTICE TO PERSONS RECEIVING THIS DRAWING
THIS PLAN AND DRAWING IS THE EXCLUSIVE PROPERTY OF ADALET. IT IS LOANED SUBJECT TO RETURN UPON REQUEST AND IN CONSIDERATION AGREES NOT TO COPY, REPRODUCE OR LOAN TO OTHERS, NOR USE IN WHOLE OR IN PART FOR THE MANUFACTURE OF SIMILAR APPARATUS WITHOUT WRITTEN PERMISSION. THIS AGREEMENT TO BE VOID.

MATERIAL
FINISH TUMBLAST
CAT NO XCE/XJF 122408

TITLE MODIFIED XCE/XJF 122408 ENCLOSURE FOR

DRAWN BY	DDH	DATE	11-12-01
ENG APPROVAL		PLOT SCALE	1=4
MFG APPROVAL		DWG SIZE	D
DWG NO		SHT	1OF1
		REV	