REV	REVISION	BY	ECN	DATE

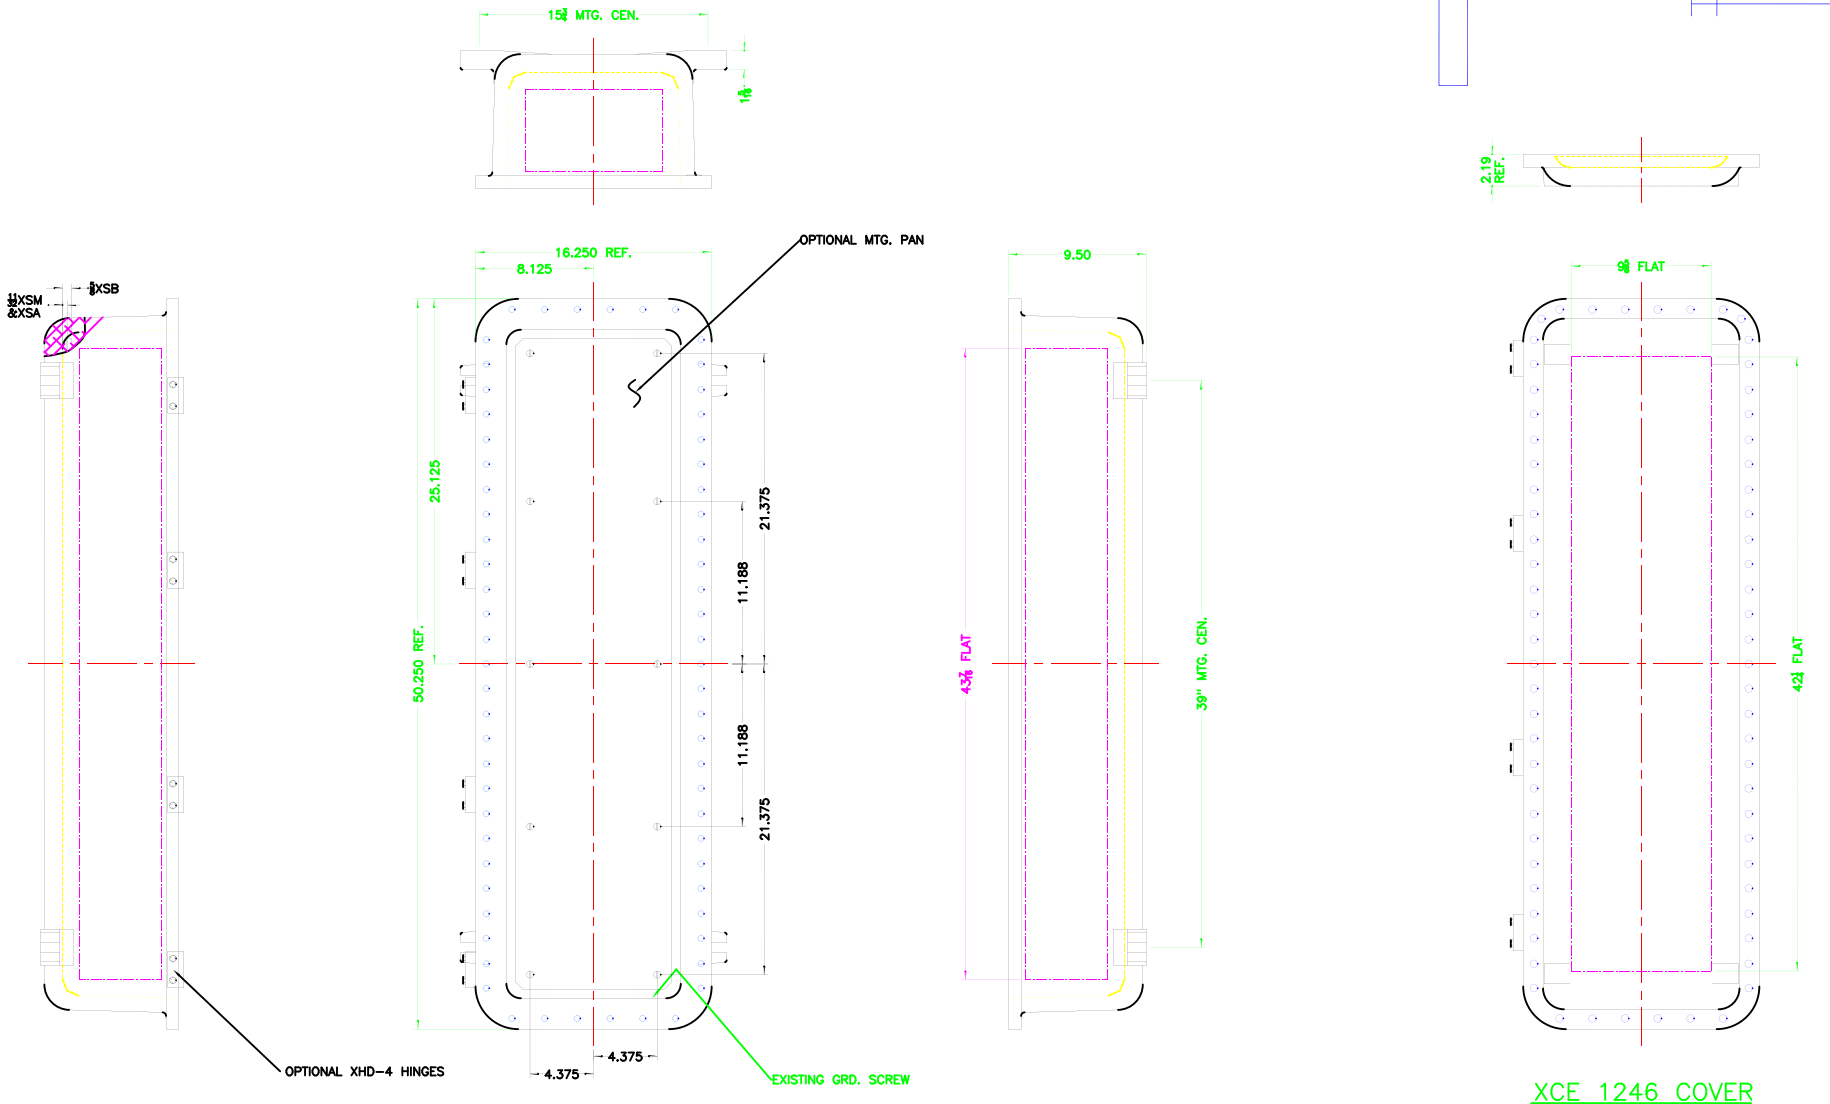

XCE 1246 COVER

COVER DRILLING ALLOWABLE IN XCE ONLY

NOTES:

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1⅛.
2. MINIMUM SPACING BETWEEN ¾–14 NPSM OPERATOR CENTERS IS 3 FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 42.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE ⅜ BOLT.

DO NOT SCALE DRAWING
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES.
MATERIAL
FINISH TUMBLAST
CAT NO XCE/XJF 124608

ADALET
A SCOTT FETZER COMPANY
Enclosure Systems Cable Accessories

TITLE MODIFIED XCE/XJF 124608 ENCLOSURE FOR

DRAWN BY	DDH	DATE	11–13–01
ENG APPROVAL		PLOT SCALE	1=4.5
MFG APPROVAL		DWG SIZE	D
DWG NO		SHT	1OF1
		REV	