


**XCE 1414 COVER**

**NOTES:**

COVER DRILLING ALLOWABLE IN XCE ONLY

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1 1/4.
2. MINIMUM SPACING BETWEEN 2-14 NPSM OPERATOR CENTERS IS 3 FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 16.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE 1/2 BOLT.

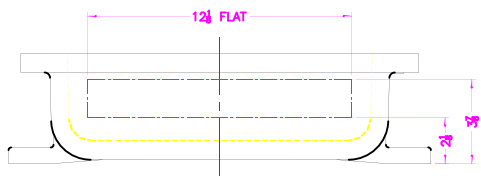

DO NOT SCALE DIMENSIONS	<b>ADALET</b> A SCOTT PETERSON COMPANY Enclosure Systems Cable Accessories	TITLE	
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES		MODIFIED XCE/XJF 141404 ENCLOSURE FOR	
ALL DIMENSIONS TO UNLESS OTHERWISE SPECIFIED	DRAWN BY DDH DATE 11-13-01 CHECKED BY DDH DATE 11-13-01 APPROVED BY DDH DATE 11-13-01	DATE 11-13-01 DRAWN BY DDH DATE 11-13-01 CHECKED BY DDH DATE 11-13-01 APPROVED BY DDH DATE 11-13-01	DATE 11-13-01 DRAWN BY DDH DATE 11-13-01 CHECKED BY DDH DATE 11-13-01 APPROVED BY DDH DATE 11-13-01
FINISH TUMBLAST	PART NO XCE/XJF 141404 QTY NO	DATE 11-13-01 DRAWN BY DDH DATE 11-13-01 CHECKED BY DDH DATE 11-13-01 APPROVED BY DDH DATE 11-13-01	DATE 11-13-01 DRAWN BY DDH DATE 11-13-01 CHECKED BY DDH DATE 11-13-01 APPROVED BY DDH DATE 11-13-01