


XCE 1414 COVER

- NOTES:
- COVER DRILLING ALLOWABLE IN XCE ONLY
1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1 1/8.
 2. MINIMUM SPACING BETWEEN 3-14 NPSM OPERATOR CENTERS IS 3 FOR THIS ENCLOSURE.
 3. MAXIMUM NUMBER OF OPERATORS IS 16.
 4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
 5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
 6. FOR MTG. ENCLOSURE USE 1/2 BOLT.

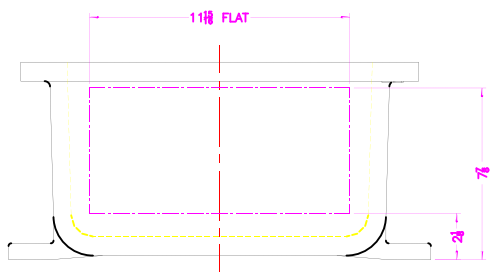

DO NOT SCALE DRAWING UNLESS SPECIFICALLY NOTED CONSTRUCTION OF THIS DRAWING IS TO BE MADE IN ACCORDANCE WITH THE DIMENSIONS AND TOLERANCES INDICATED UNLESS OTHERWISE SPECIFIED IN THE DRAWING DIMENSIONS ARE IN INCHES UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN FEET AND INCHES UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN METERS UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN METERS UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN METERS UNLESS OTHERWISE SPECIFIED	ADALET A SCOTT FITZGER COMPANY Electrical Systems Cable Assembly 12345 Main Street City, State, ZIP Phone: (000) 000-0000 Fax: (000) 000-0000 E-Mail: info@adalet.com Website: www.adalet.com © 2000 ADALET All Rights Reserved	FILE MODIFIED XCE/XIF 141408 ENCLOSURE FOR DRAWN BY: DDH DATE: 11-13-01 DESIGNED BY: DDH DATE: 11-13-01 CHECKED BY: DDH DATE: 11-13-01 APPROVED BY: DDH DATE: 11-13-01 PROJECT NO: 10F1
---	--	--