


XCE 1616 COVER

NOTES:

COVER DRILLING ALLOWABLE IN XCE ONLY

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1 1/8.
2. MINIMUM SPACING BETWEEN 3-14 NPSM OPERATOR CENTERS IS 3 1/2 FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 16.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE 3/8 BOLT.

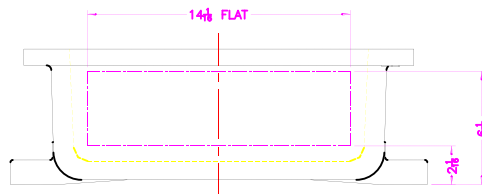

DO NOT SCALE DIMENSIONS UNLESS OTHERWISE NOTED. DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED. ALL DIMENSIONS ARE TO CENTER UNLESS OTHERWISE NOTED. DIMENSIONS TO CENTER UNLESS OTHERWISE NOTED. DIMENSIONS TO CENTER UNLESS OTHERWISE NOTED.	ADALET A SCOTT PETERSON COMPANY Electrical Systems Cable Accessories	TITLE MODIFIED XCE/XIF 161606 ENCLOSURE FOR
DATE TO BE REVIEWED: 11/14/01 DRAWN BY: DDH DATE: 11-14-01 CHECKED BY: TUMBLAST DATE: 11-14-01 APPROVED BY: TUMBLAST DATE: 11-14-01 PROJECT: XCE/XIF 161606 SHEET NO: 10F1	DRAWN BY: DDH DATE: 11-14-01 CHECKED BY: TUMBLAST DATE: 11-14-01 APPROVED BY: TUMBLAST DATE: 11-14-01 PROJECT: XCE/XIF 161606 SHEET NO: 10F1	DRAWN BY: DDH DATE: 11-14-01 CHECKED BY: TUMBLAST DATE: 11-14-01 APPROVED BY: TUMBLAST DATE: 11-14-01 PROJECT: XCE/XIF 161606 SHEET NO: 10F1