REV	REVISION	BY	ECN	DATE

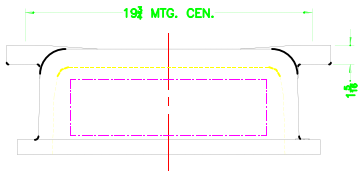



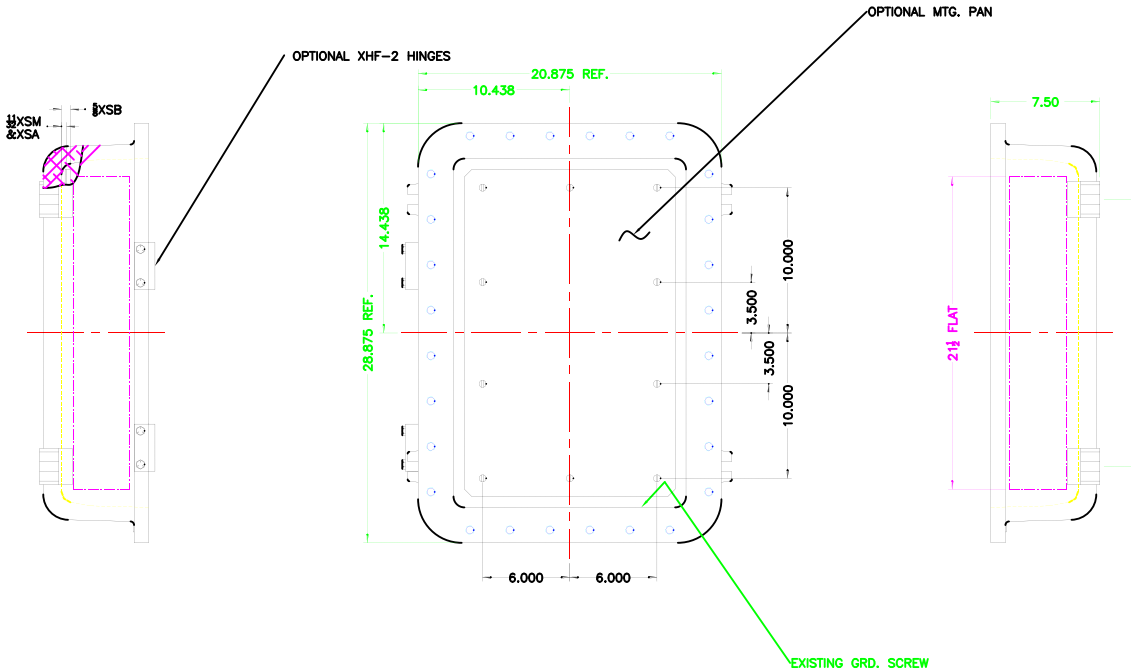

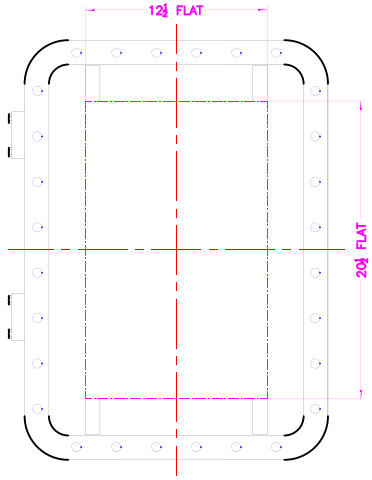

XCE 1624 COVER

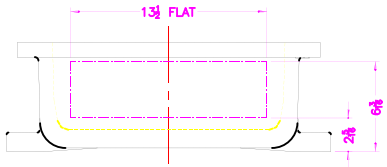

COVER DRILLING ALLOWABLE IN XCE ONLY

NOTES:

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1 1/16.
2. MINIMUM SPACING BETWEEN ¾–14 NPSM OPERATOR CENTERS IS 3¼ FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 24.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE ⅜ BOLT.

DO NOT SCALE DRAWING
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES.
CAST TOLERANCES ON DIMENSIONS NOT OTHERWISE SPECIFIED:
± 1/8" RADIUS
FILLET TO CORNER RADII 1/8"
DRAFT 1°
FINISH 63 µ/in
ANGLES 1°
MACHINE TOLERANCES ON DIMENSIONS NOT OTHERWISE SPECIFIED:
± 1/64"
FILLET RAD .XXX ± .010"
ANGLE MACH. .XX" ± .010" & .XX" ± .010" & 45°
ANGLE 0°–30°
CASTING DRILLING HOLES
BOLT THROUGH
NPSM ¾–14

ADALET
A SCOTT FETZER COMPANY
Enclosure Systems Cable Accessories

NOTICE TO PERSONS RECEIVING THIS DRAWING
WHILE THE CONTENTS, INCLUDING DESIGN, IN THIS DRAWING ARE BELIEVED TO BE ACCURATE, THEY ARE SUPPLIED FOR INFORMATIVE PURPOSES ONLY AND SHOULD NOT BE RELIED UPON WITHOUT INDEPENDENT VERIFICATION AS TO THEIR ACCURACY AND SUITABILITY FOR A PARTICULAR APPLICATION. ADALET RESERVES THE RIGHT TO MAKE CHANGES WITHOUT NOTICE IN THE DESIGN, MATERIALS, PROCESS, STANDARDS AND SPECIFICATIONS FROM WHICH THIS DRAWING IS MADE.

MATERIAL
FINISH TUMBLAST
CAT NO XCE/XJF 162406

TITLE MODIFIED XCE/XJF 162406 ENCLOSURE FOR

DRAWN BY	DDH	DATE	11–15–01
ENG APPROVAL		PLOT SCALE	1=4.5
MFG APPROVAL		DWG SIZE	D
DWG NO		SHT	1OF1
		REV	