
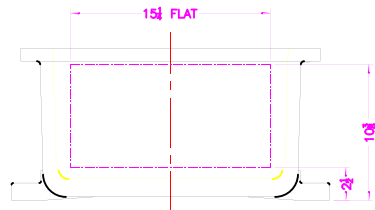
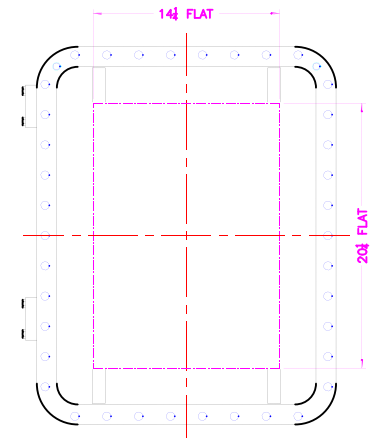
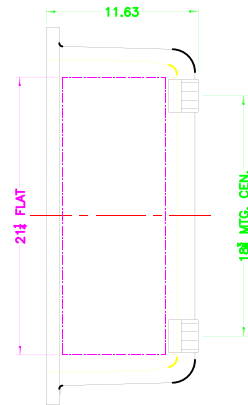


OPTIONAL XHF-2 HINGES

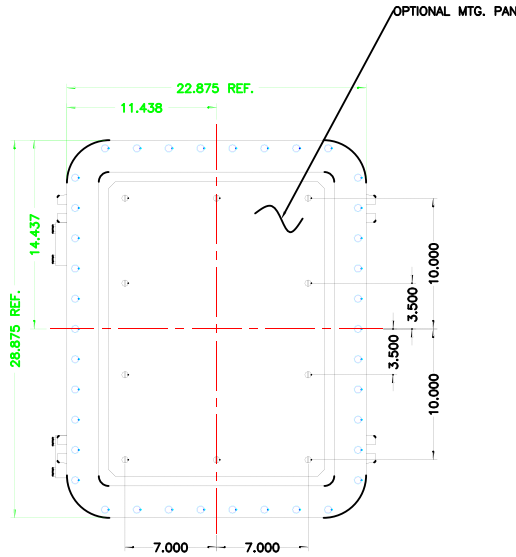

XCE 1824 COVER

- NOTES:
1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1 1/8.
 2. MINIMUM SPACING BETWEEN 3-14 NPSM OPERATOR CENTERS IS 3/2 FOR THIS ENCLOSURE.
 3. MAXIMUM NUMBER OF OPERATORS IS 24.
 4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
 5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
 6. FOR MTG. ENCLOSURE USE 3/8 BOLT.

COVER DRILLING ALLOWABLE IN XCE ONLY

DO NOT SCALE DIMENSIONS UNLESS SHOWN OTHERWISE DIMENSIONS IN INCHES UNLESS NOTED OTHERWISE DIMENSIONS IN MILLIMETERS UNLESS NOTED OTHERWISE FITTED TO COVER MOD 1/8" SCALE: 1/4" DATE: 11-16-01 PROJECT NO: 2001 & 2107 SHEET NO: 1 OF 10 DESIGNER: TUMBLAST CHECKED: J. S. S. SPEER APP'D: J. S. S. SPEER		ADALET A SCOTT PETERSON COMPANY Enclosure Systems Cable Accessories		TITLE MODIFIED XCE/XIF 182410 ENCLOSURE FOR DRAWN BY DDH DATE 11-16-01 DWG APPROVAL DATE 11-16-01 DWG SCALE 1=5 DWG NO. D REV D 10F1	
---	--	--	--	---	--