


XCE 203606

NOTES:

COVER DRILLING ALLOWABLE IN XCE ONLY

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1 1/8.
2. MINIMUM SPACING BETWEEN 2-14 NPSM OPERATOR CENTERS IS 3/8 FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 45.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE 1/2 BOLT.

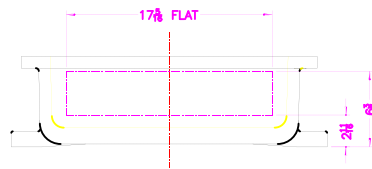

DO NOT SCALE DIMENSIONS UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES DIMENSIONS IN PARENTHESES ARE FOR INFORMATION ONLY TOLERANCES UNLESS SPECIFIED: DIMENSIONS TO CENTER UNLESS SPECIFIED DIMENSIONS TO SURFACE UNLESS SPECIFIED DIMENSIONS TO EDGE UNLESS SPECIFIED DIMENSIONS TO CORNER UNLESS SPECIFIED DIMENSIONS TO CENTER UNLESS SPECIFIED DIMENSIONS TO SURFACE UNLESS SPECIFIED DIMENSIONS TO EDGE UNLESS SPECIFIED DIMENSIONS TO CORNER UNLESS SPECIFIED	<p>ADALET A SCOTT PETERSON COMPANY Business Systems Cable Enclosures</p> <p>DATE IS PROVIDED UNLESS OTHERWISE SPECIFIED REVISIONS AND REVISIONS SHALL BE IN THE FORM OF A REVISION SHEET AND SHALL BE APPROVED BY THE ORIGINAL DESIGNER AND THE CUSTOMER ALL DIMENSIONS SHALL BE IN INCHES UNLESS OTHERWISE SPECIFIED DIMENSIONS TO CENTER UNLESS SPECIFIED DIMENSIONS TO SURFACE UNLESS SPECIFIED DIMENSIONS TO EDGE UNLESS SPECIFIED DIMENSIONS TO CORNER UNLESS SPECIFIED</p> <p>FINISH: TUMBLAST</p> <p>QTY NO: XCE 203606</p>	<p>TITLE: MODIFIED XCE 203606 ENCLOSURE FOR</p> <p>DRAWN BY: DDH DATE: 01-07-02</p> <p>ENG APPROVAL: DATE: 1=5.5</p> <p>MFG APPROVAL: DATE: D</p> <p>REV: 10F1</p>
--	---	--