




OPTIONAL MTG. PAN

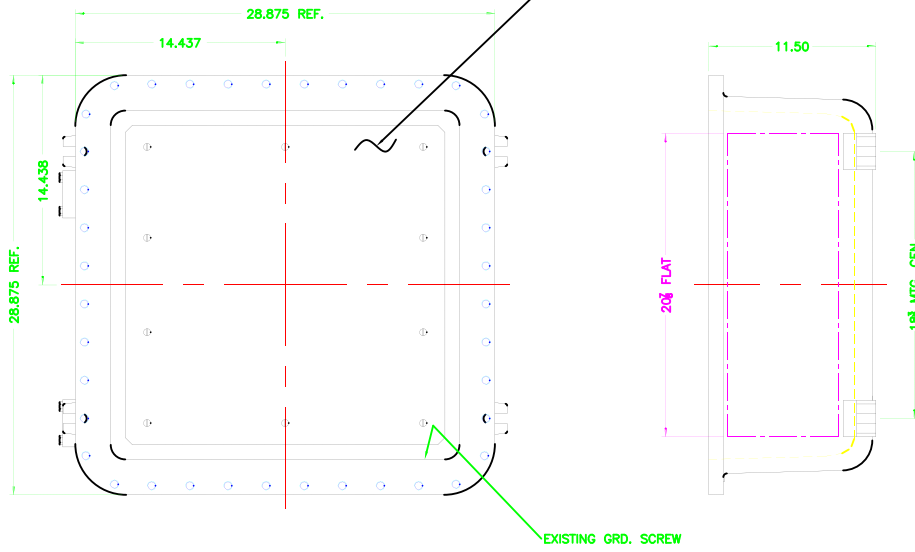


EXISTING GRD. SCREW

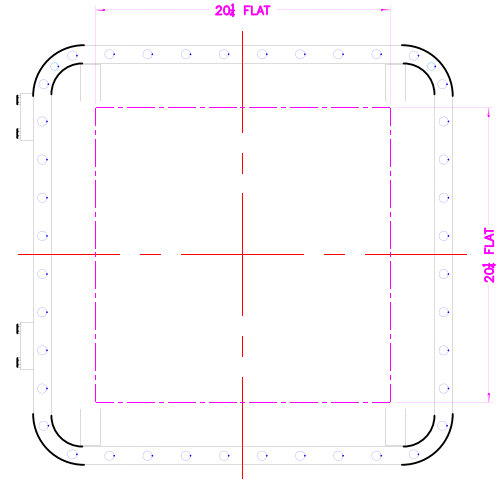

XCE 2424 COVER

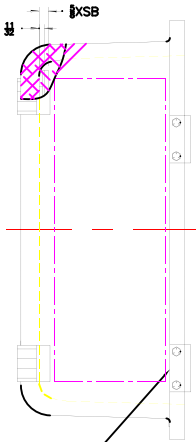

OPTIONAL XHF-2 HINGES

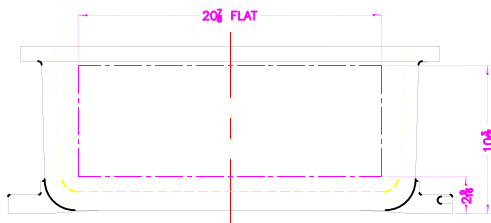

NOTES:

COVER DRILLING ALLOWABLE IN XCE ONLY

- 1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1 1/8."
- 2. MINIMUM SPACING BETWEEN 3-14 NPSM OPERATOR CENTERS IS 3 3/4" FOR THIS ENCLOSURE.
- 3. MAXIMUM NUMBER OF OPERATORS IS 36.
- 4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
- 5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
- 6. FOR MTG. ENCLOSURE USE 3/8" BOLT.

<small>DO NOT SCALE DRAWING UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES DIMENSIONS IN PARENTHESIS ARE OPTIONAL DIMENSIONS IN SQUARE BRACKETS ARE NOT TO SCALE DIMENSIONS IN CIRCLES ARE DIA. DIMENSIONS IN TRIANGLES ARE ANGLE DIMENSIONS IN DASHES ARE HOLE LOCATIONS DIMENSIONS IN DIMENSIONAL BLOCKS ARE DIMENSIONS DURING MANUFACTURE UNLESS OTHERWISE SPECIFIED DIMENSIONS IN DIMENSIONAL BLOCKS ARE DIMENSIONS DURING MANUFACTURE UNLESS OTHERWISE SPECIFIED</small>	ADALET A SCOTT PETERSEN COMPANY Industrial Systems Cable Enclosures	TITLE MODIFIED XCE/XIF 242410 ENCLOSURE FOR			
		DATE	01-08-02	SCALE	1=4.5
DESIGNED BY	DDH	DATE	D	REV	10F1
APPROVED BY		DWG NO.			
CHECKED BY		DATE			
MATERIAL		FINISH	TUMBLAST		
QTY		DWG NO.			
DATE					