


OPTIONAL XHF-3 HINGE

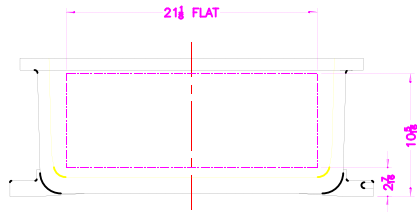

XCE 2436D COVER

NOTES:

COVER DRILLING ALLOWABLE IN XCE ONLY

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1 1/8".
2. MINIMUM SPACING BETWEEN 3-14 NPSM OPERATOR CENTERS IS 3 3/4" FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 54.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE 3/8" BOLT.

<small>DO NOT SCALE DIMENSIONS</small> <small>UNLESS OTHERWISE SPECIFIED</small> <small>CONFORM TO THE 2018 ASME Y14.5</small> <small>DATE: 09/17/2018</small> <small>SCALE: 1"=5.5'</small> <small>UNIT: INCHES</small> <small>DECIMALS: 1/16"</small> <small>FRAC: 1/16"</small> <small>ANGLE: 1/2°</small> <small>SPACING: 0.005"</small> <small>FINISH: 304 & 316L</small> <small>WELD: 1/8" 304 & 316L</small> <small>DRG: 2-23-18</small>	ADALET <small>A SCOTT PETERSON COMPANY</small> <small>Enclosure Systems</small> <small>Circle 1000/1001</small>	<small>TITLE</small> MODIFIED XCE 243612 ENCLOSURE FOR	
		<small>DATE: 09/17/2018</small> <small>SCALE: 1"=5.5'</small> <small>UNIT: INCHES</small> <small>DECIMALS: 1/16"</small> <small>FRAC: 1/16"</small> <small>ANGLE: 1/2°</small> <small>SPACING: 0.005"</small> <small>FINISH: 304 & 316L</small> <small>WELD: 1/8" 304 & 316L</small> <small>DRG: 2-23-18</small>	<small>DRAWN BY</small> AAM
<small>SEE NOTES</small> TUMBLAST	<small>APP. APPROVAL</small> TUMBLAST	<small>DATE</small> D	<small>REV</small> 10F1
<small>DATE</small> XCE 243612	<small>DATE</small> XCE 243612	<small>DATE</small> XCE 243612	<small>DATE</small> XCE 243612