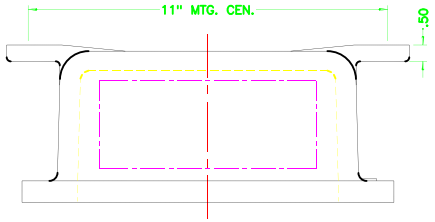



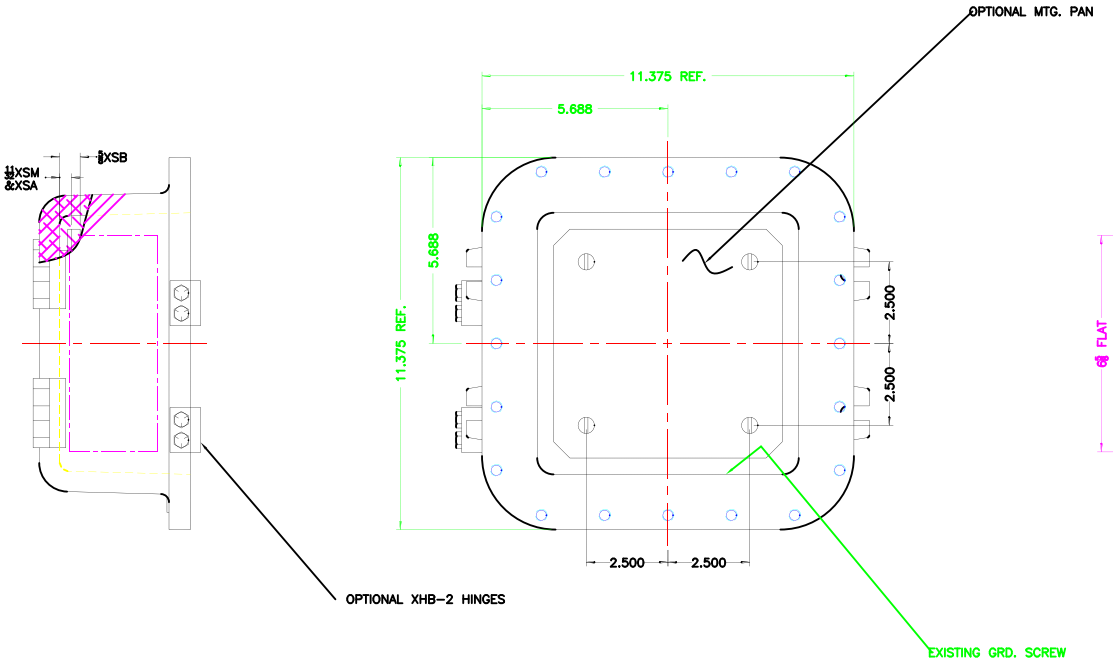

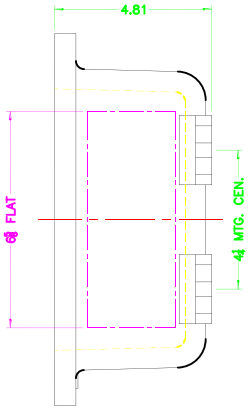

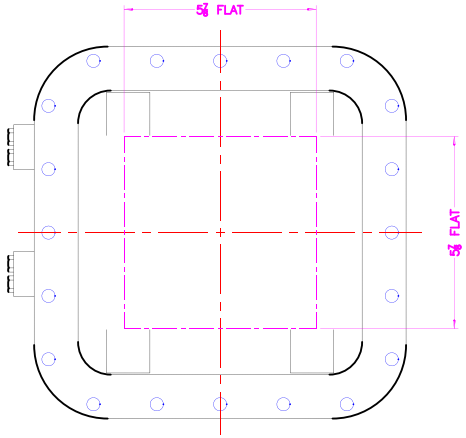

XCE 0808 COVER

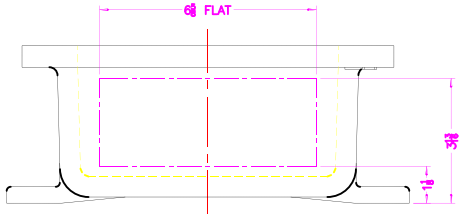

COVER DRILLING ALLOWABLE IN XCE ONLY

NOTES:

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1 1/16.
2. MINIMUM SPACING BETWEEN ¾–14 NPSM OPERATOR CENTERS IS 2¾ FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 4.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE 3/8 BOLT.

REV	REVISION	BY	ECN	DATE

DO NOT SCALE DRAWING

ADALET
A SCOTT FETZER COMPANY
Enclosure Systems Cable Accessories

TITLE: MODIFIED XCE/XJF 080804 ENCLOSURE FOR

DRAWN BY	DDH	DATE	6-12-01
ENG APPROVAL		PLOT SCALE	1=2
MFG APPROVAL		DWG SIZE	D
FINISH	TUMBLAST	DWG NO	
CAT NO	XCE/XJF 080804	SHT	1OF1
		REV	