REV	REVISION	BY	ECN	DATE

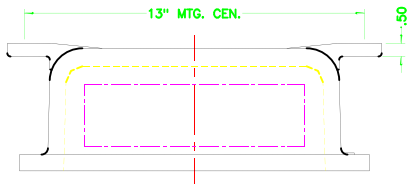



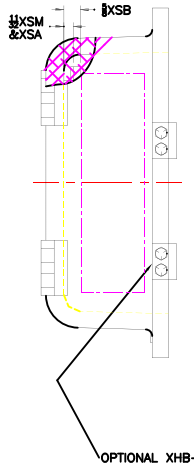

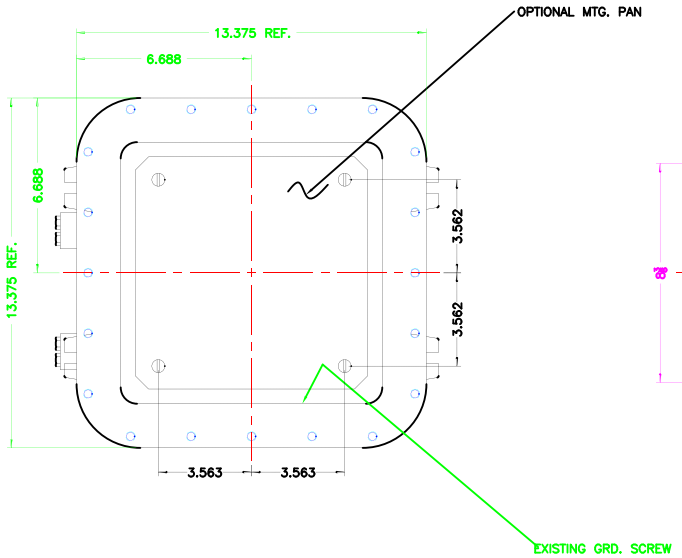

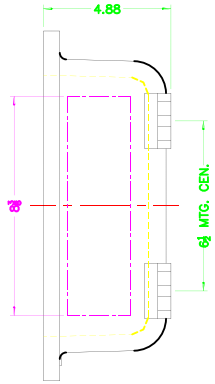

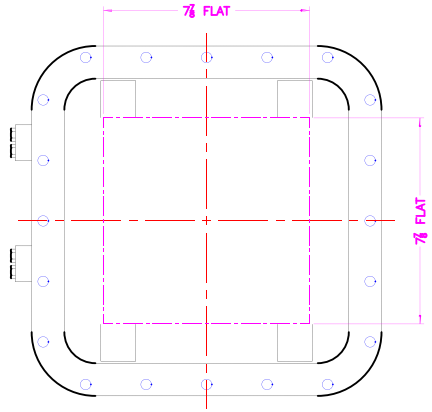

XCE 1010 COVER

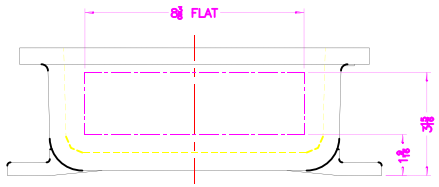

COVER DRILLING ALLOWABLE IN XCE ONLY

NOTES:

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS $1\frac{1}{16}$.
2. MINIMUM SPACING BETWEEN $\frac{3}{4}$–14 NPSM OPERATOR CENTERS IS $2\frac{1}{2}$ FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 9.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE 3/8 BOLT.

DO NOT SCALE DRAWING
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES.
CAST TOLERANCES ON DIMENSIONS NOT OTHERWISE SPECIFIED:
± 1/8" BASIC
FILLET OR CORNER RADII 1/8"
DRAFT 1°
TYP. 0.1/2"
ANGLES 1°
MACHINE TOLERANCES ON DIMENSIONS NOT OTHERWISE SPECIFIED:
± 1/64"
FINISH .XXX ± .010"
FILLET RAD. .XX" ± .010"
THREAD MINOR .XXX" ± .010" R. or 45°
ANGLES 0°-30'
CASTING HOLE TOLERANCES
HOLES NOT SPECIFIED
NPSM C-2
NPTF C-2

ADALET
A SCOTT FETZER COMPANY
Enclosure Systems Cable Accessories

NOTICE TO PERSONS RECEIVING THIS DRAWING
WHAT IS THE LEGAL PROPRIETARY RIGHTS IN THE SUBJECT MATTER HEREIN. THIS DRAWING IS ISSUED IN CONFIDENCE FOR INFORMATION & EVALUATION ONLY AND NOT FOR U.S. EXPORTATION OR REPRODUCTION. ANYONE ACCEPTING THIS DRAWING AGREES TO RETURN IT UPON REQUEST OR UPON COMPLETION OF THE USE.

MATERIAL
FINISH TUMBLAST
CAT NO XCE/XJF 101004

TITLE MODIFIED XCE/XJF 101004 ENCLOSURE FOR

DRAWN BY	DDH	DATE	6-13-01
ENG APPROVAL		PLOT SCALE	1=2.5
MFG APPROVAL		DRG SIZE	D
DRG NO		SHT	1OF1
		REV	