

XCE 1836 COVER

NOTES:

COVER DRILLING ALLOWABLE IN XCE ONLY


1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1 1/8.
2. MINIMUM SPACING BETWEEN 3-14 NPSM OPERATOR CENTERS IS 3 1/2 FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 36.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE 3/8 BOLT.

MODIFIED XCE/XJF 183610 ENCLOSURE FOR

DDH 11-16-01
1=5.25
D

TUMBLAST
XCE/XJF 183610

10F1

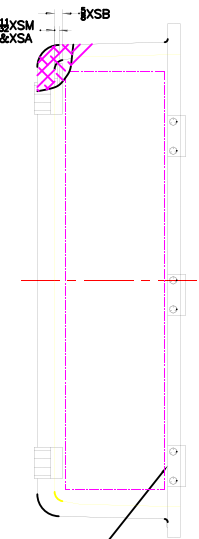

OPTIONAL XHF-3 HINGES

